


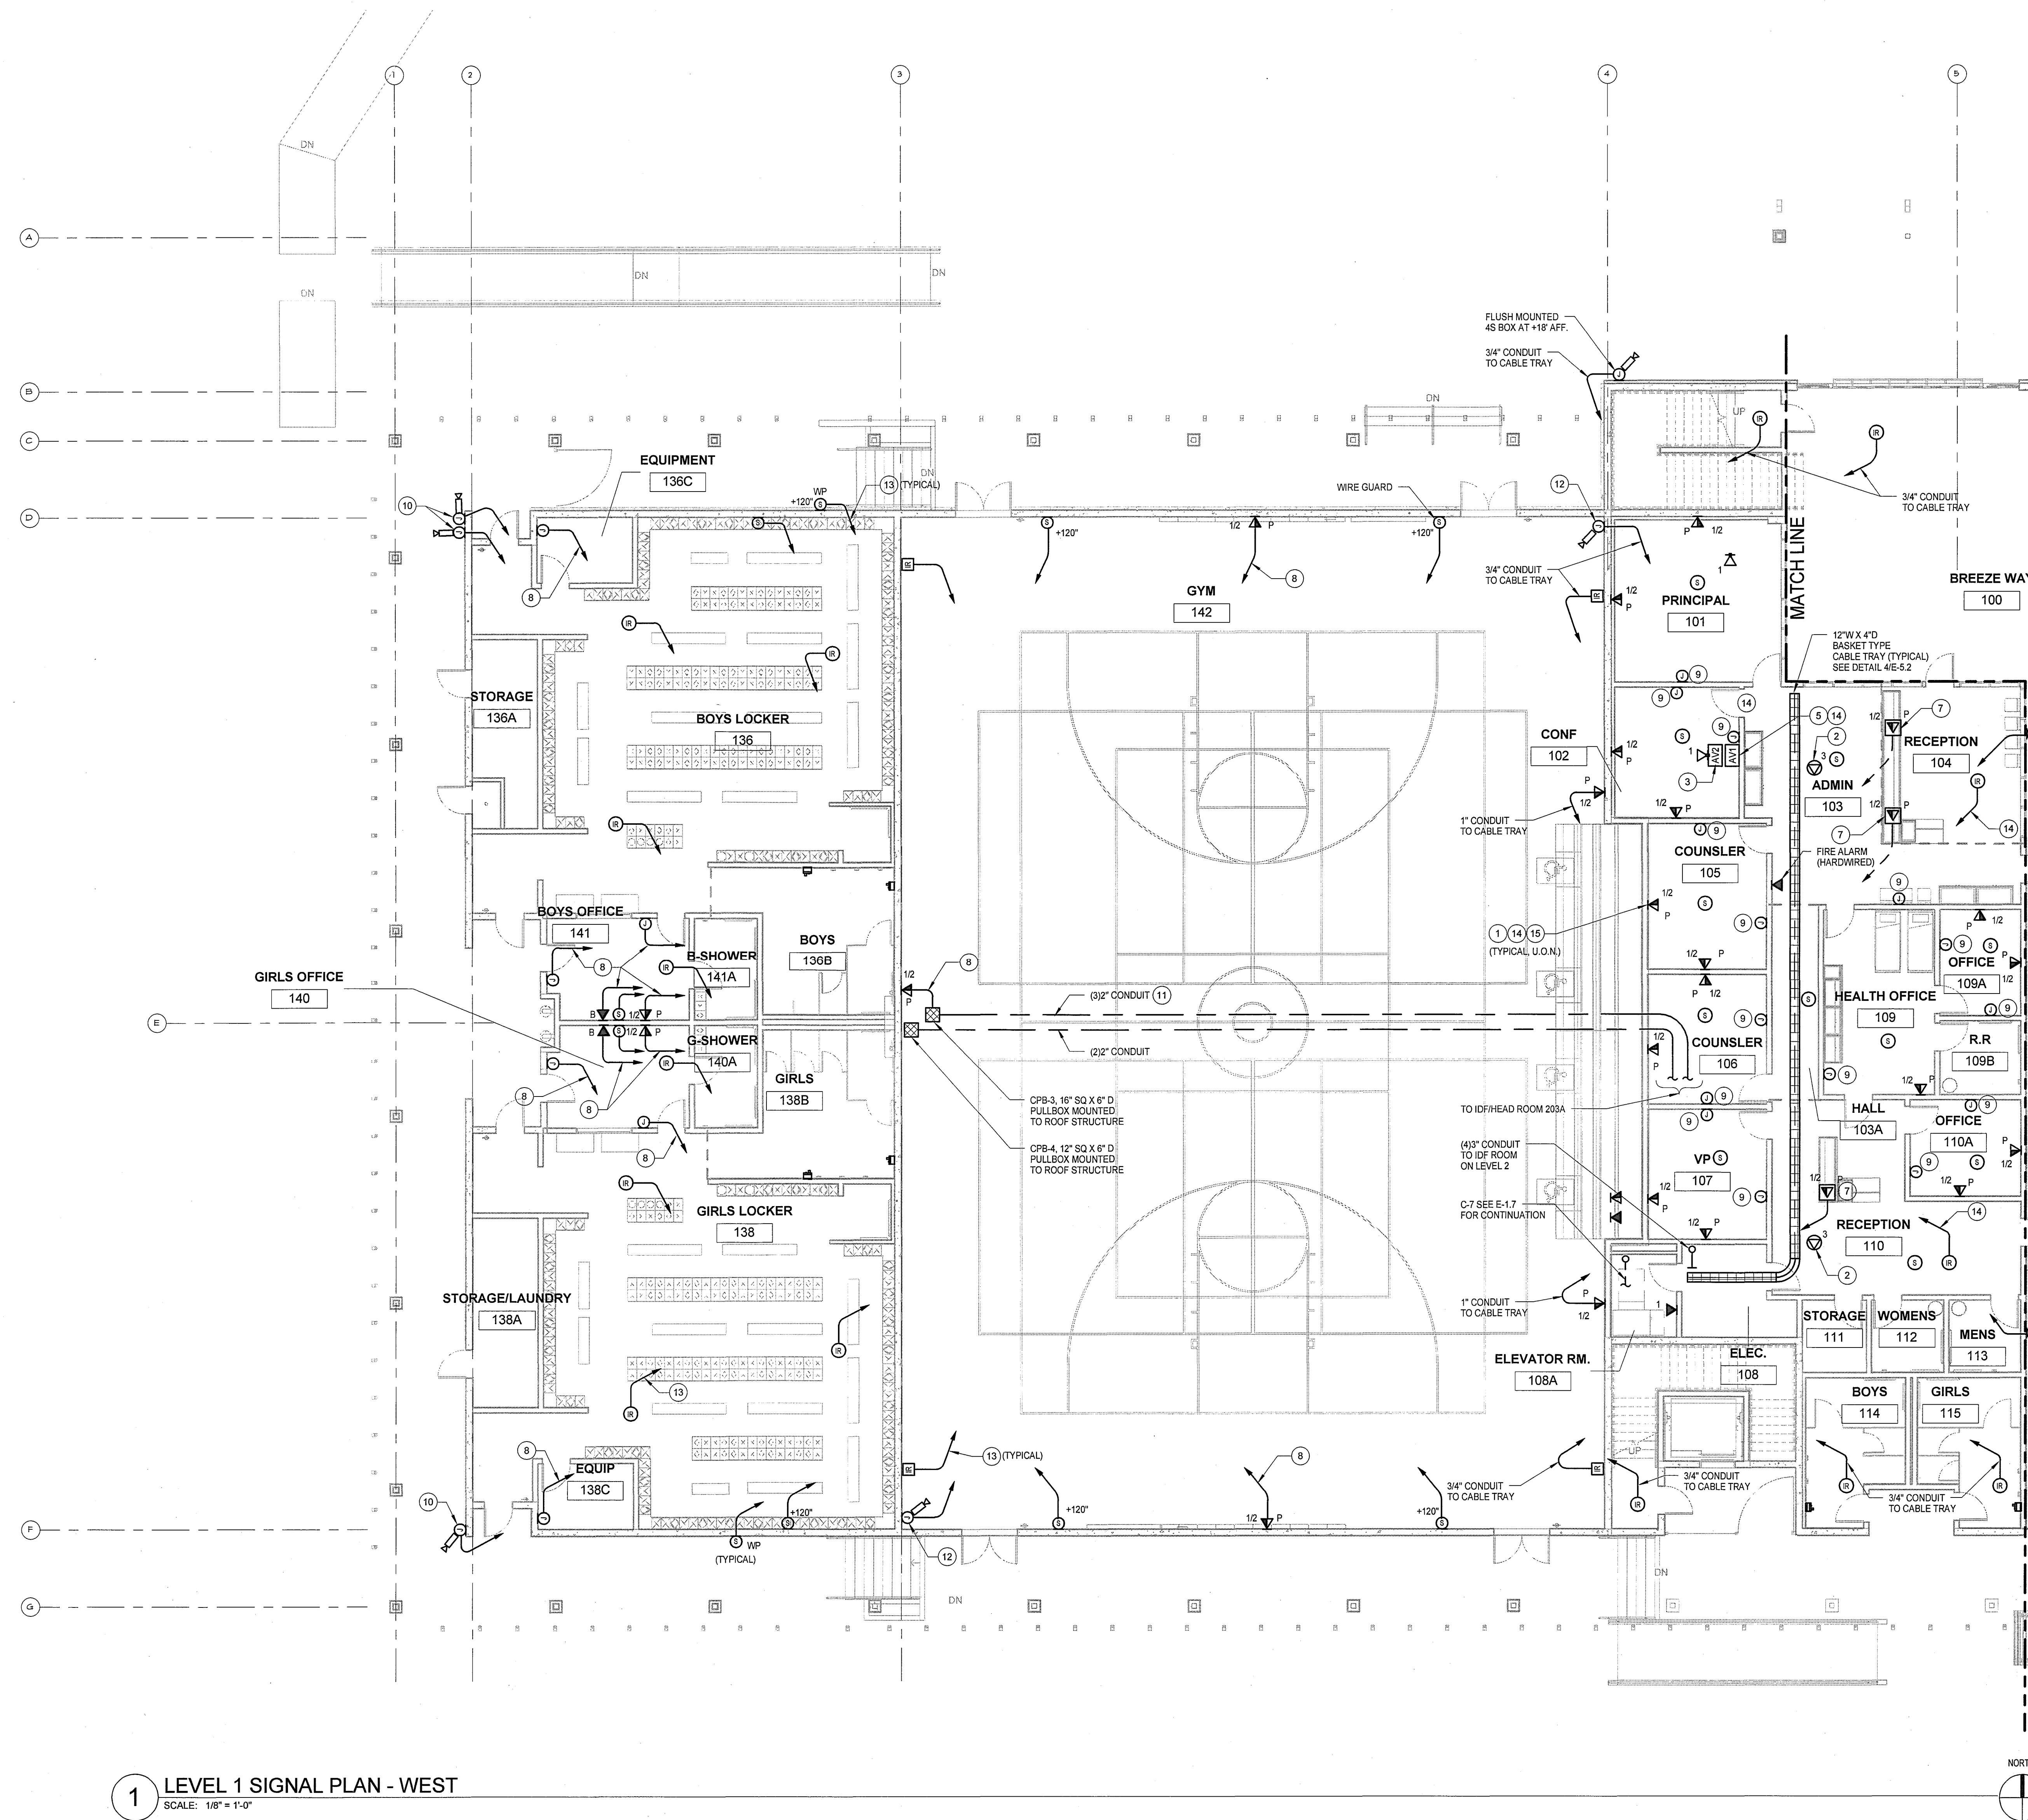


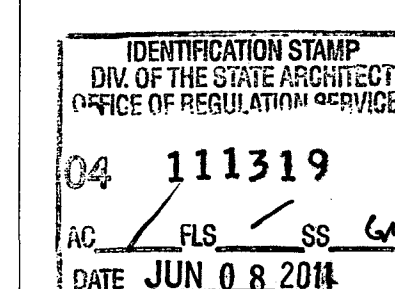

1 LEVEL 1 SIGNAL PLAN - WEST
SCALE: 1/8" = 1'-0"


KEYNOTES	
1	WALL MOUNTED DATA OUTLET. PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACES.
2	DATA OUTLET MOUNTED ON WALL AT PROJECTOR LOCATION. COORDINATE LOCATION WITH AV CONTRACTOR.
3	AV PROJECTOR LOCATION ON WALL. PROVIDE 1 1/4" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE SEE 1/ET-5.2 FOR DETAIL.
4	DATA OUTLET MOUNTED FLUSH IN CENTER OF CEILING FOR FUTURE WIRELESS ACCESS POINT.
5	AV OUTLET MOUNTED ON WALL +18". SEE 2/ET-5.2 FOR DETAIL. PROVIDE 1 1/4" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE.
6	NOT USED.
7	FLOOR MOUNTED DATA OUTLET. PROVIDE 1" CONDUIT TO IDF/HEADEND ROOM 203A ON LEVEL 2. COORDINATE WITH CASEWORK INSTALLATION.
8	PROVIDE 1" CONDUIT TO CPB-3, U.O.N.
9	FUTURE DATA OUTLET AT +18". PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE. U.O.N. CONTRACTOR TO PROVIDE PULLSTRING AND BLANK COVER PLATE.
10	CCTV CAMERA LOCATION. PROVIDE FLUSH MOUNTED 4S BOX MOUNTED AT +18" U.O.N. PROVIDE 3/4" CONDUIT TO CPB-4, U.O.N.
11	DATA CABLEING CONTRACTOR TO LEAVE (1) CONDUIT OPEN FOR FUTURE CABLEING NEEDS. PROVIDE PULLSTRING IN OPEN CONDUIT.
12	CCTV CAMERA LOCATION. PROVIDE SURFACE MOUNTED 4S BOX AT 12" AFF. U.O.N. PROVIDE 3/4" CONDUIT TO CPB-4, U.O.N.
13	PROVIDE 3/4" CONDUIT TO CPB-4, U.O.N.
14	PROVIDE J-HOOK PATHWAY TO CABLE TRAY SUPPORT CABLES EVERY 4" WITH J-HOOK ATTACHED TO PERMANENT STRUCTURE.
15	SEE DETAIL 1/ET-5.5 AND DETAIL 2/ET-5.5 FOR LABELING DETAILS.

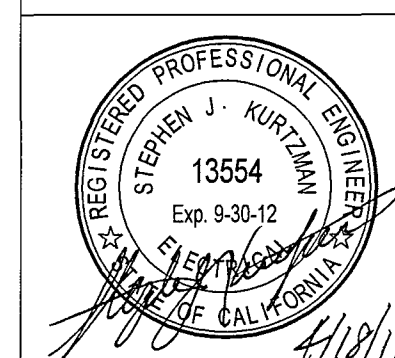

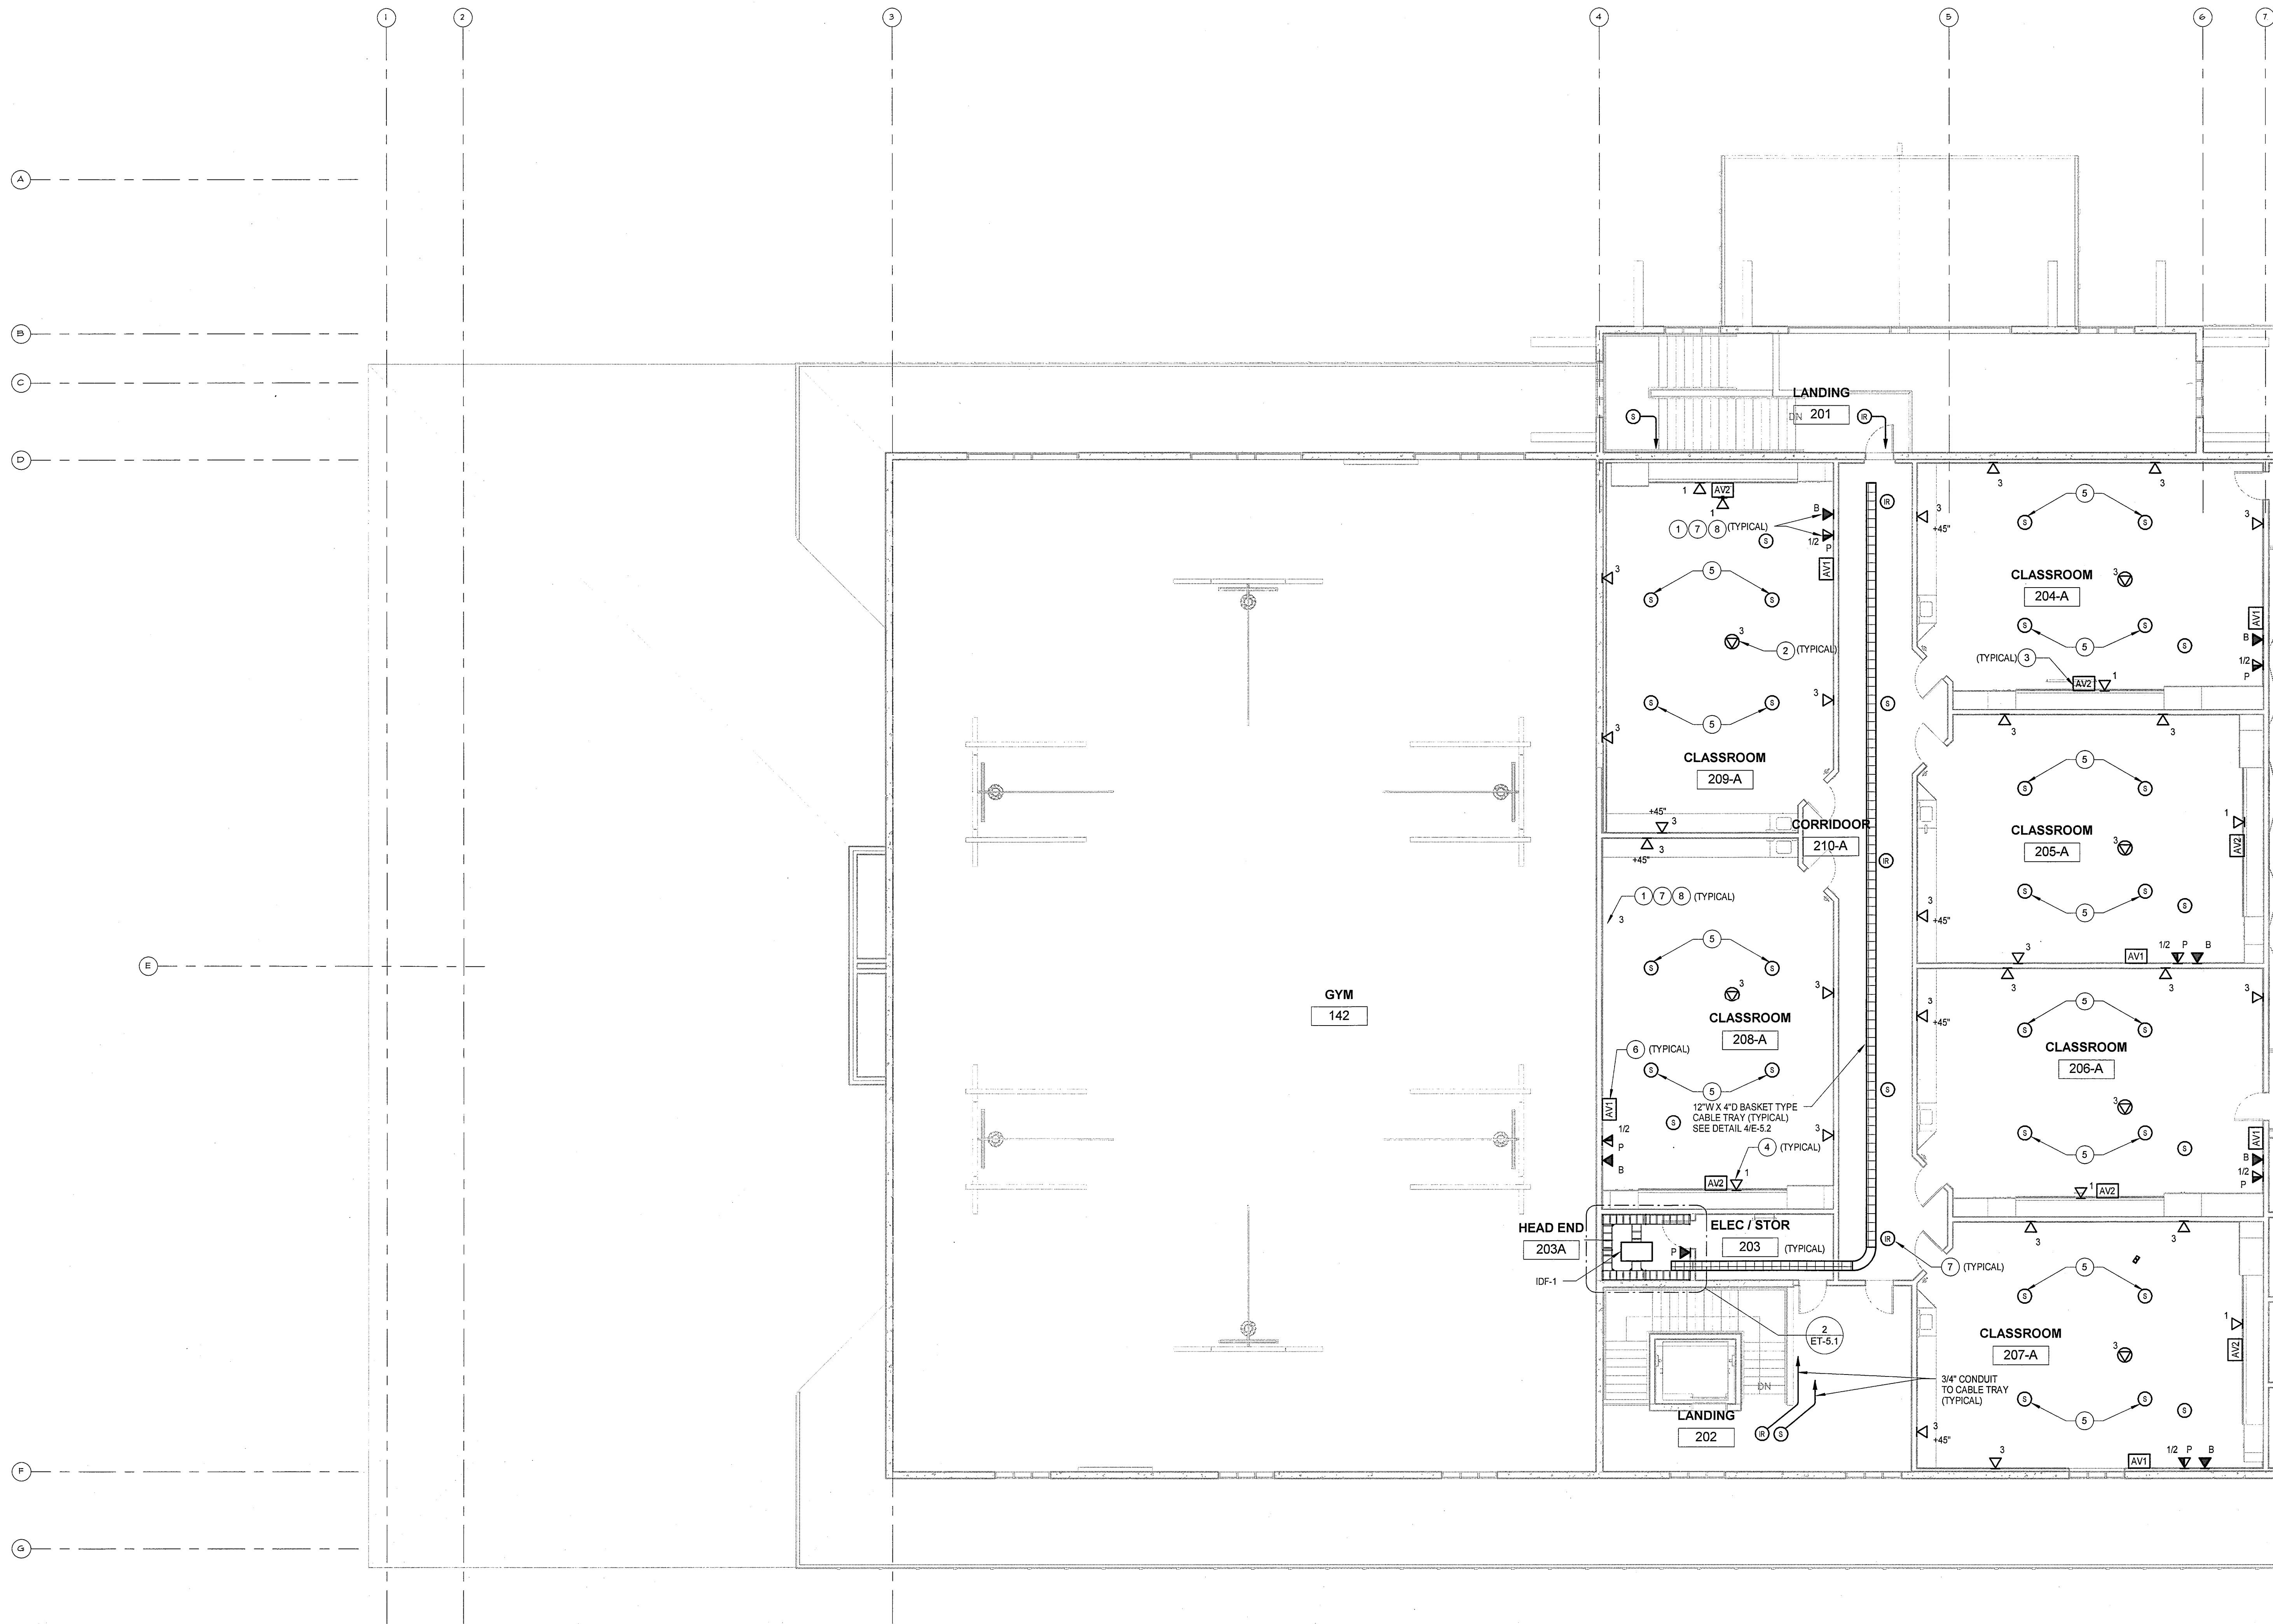

KEYNOTES	
1	WALL MOUNTED DATA OUTLET. PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACES.
2	DATA OUTLET MOUNTED FLUSH IN CENTER OF CEILING FOR FUTURE WIRELESS ACCESS POINT.
3	AV PROJECTOR LOCATION ON SOFFIT. COORDINATE LOCATION WITH ARCHITECTURAL PLANS. PROVIDE 1 1/4" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE SEE ET-5.2 FOR DETAIL.
4	DATA OUTLET MOUNTED ON FACE OF CABINET ABOVE DOORS. PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE.
5	LAY IN AV SPEAKERS MOUNTED IN CEILING. SPACE SPEAKER TO PROVIDE FOR MAXIMUM AUDIO COVERAGE. SEE ET-5.2 FOR DETAILS.
6	WALL MOUNTED AV OUTLET. STUB 1 1/4" CONDUIT INTO ACCESSIBLE CEILING SPACE. PROVIDE J-HOOK TO CABLE TRAY TO SUPPORT CABLES. SEE ET-5.2.
7	PROVIDE J-HOOK PATHWAY TO CABLE TRAY TO SUPPORT CABLES EVERY 4' WITH J-HOOK ATTACHED TO PERMANENT STRUCTURE.
8	SEE DETAIL 1/ET-5.5 AND DETAIL 2/ET-5.5 FOR LABELING DETAILS.
9	PROVIDE J-HOOK PATHWAY TO CABLE TRAY TO SUPPORT CABLES EVERY 4' WITH J-HOOK ATTACHED TO PERMANENT STRUCTURE.


1 LEVEL 2 SIGNAL PLAN
SCALE: 1/8" = 1'-0"



MARK FORTIE, RCDD
REGISTERED COMMUNICATIONS DESIGNER
BICSI
EXPIRE 12/31/11
Regis. No. 081432

TURPIN & RATTAN
ENGINEERING, INC.
CONSULTING ENGINEERS
4719 PALM AVENUE
LA MESA, CA 91941-5221
619 / 466 / 6224 FAX 466 / 6233
E-MAIL: ENGINEER@TREID.COM
10086
4/18/2011 3:32:01 PM
C:\Users\Mark Fortie\Documents\10086 GREENFIELD_A\T2p1.rvt

SPROTTE WATSON
ARCHITECTURE | PLANNING



MULTI PURPOSE BUILDING
GREEN FIELD MIDDLE SCHOOL
1485 GREENFIELD DR, EL CAJON CA, 92021
CAJON VALLEY UNION SCHOOL DISTRICT

CONSULTANT



REVISIONS

APPROVALS

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
111319
DATE JUN 08 2011

DESCRIPTION

LEVEL 2
SIGNAL PLAN

DATE


04-19-11

JOB #


10086

SHEET #

E-2.9

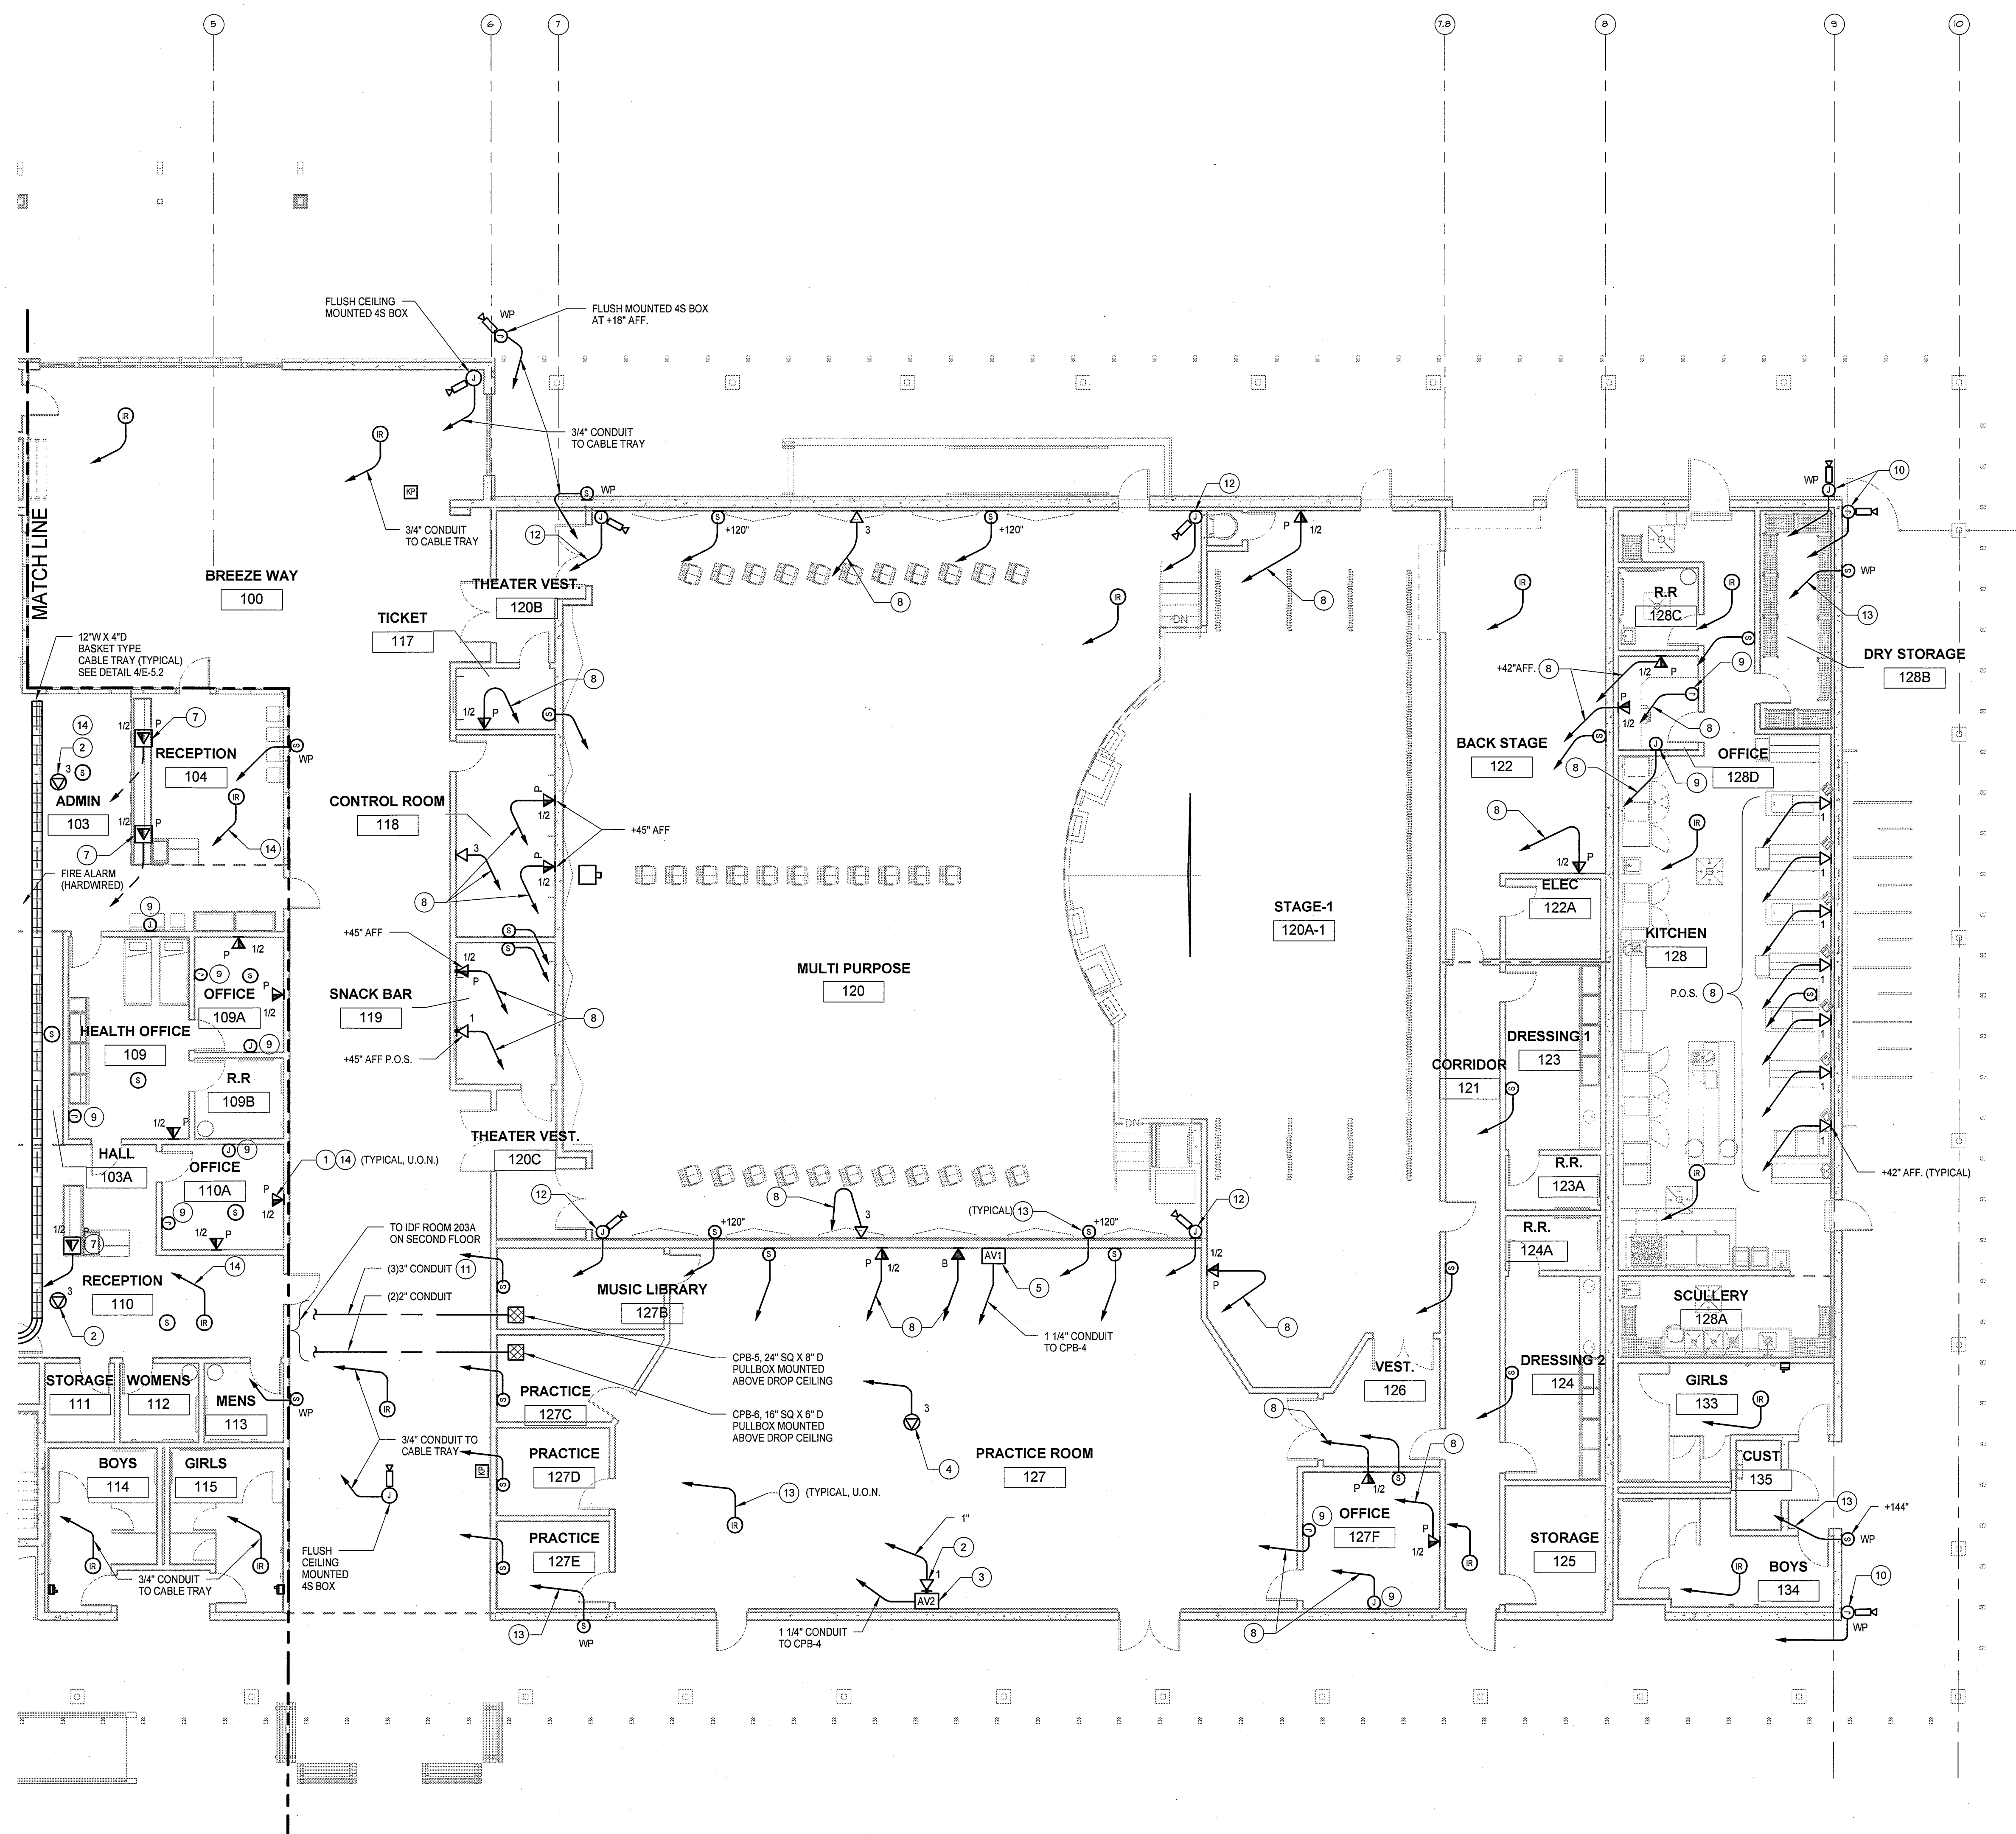

1 LEVEL 1 SIGNAL PLAN - EAST
SCALE: 1/8" = 1'-0"



KEYNOTES	
1	WALL MOUNTED DATA OUTLET. PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACES.
2	DATA OUTLET MOUNTED FLUSH IN CEILING AT PROJECTOR LOCATION. COORDINATE LOCATION WITH AV CONTRACTOR.
3	AV PROJECTOR LOCATION ON WALL. PROVIDE 1 1/4" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE SEE ET-5.2 FOR DETAIL.
4	DATA OUTLET MOUNTED FLUSH IN CENTER OF CEILING FOR FUTURE WIRELESS ACCESS POINT.
5	NOT USED.
6	NOT USED.
7	FLOOR MOUNTED DATA OUTLET. PROVIDE 1" CONDUIT TO IDF/HEADEND ROOM 203A ON LEVEL 2.
8	PROVIDE 1" CONDUIT TO CPB-5, U.O.N.
9	FUTURE DATA OUTLET. PROVIDE 1" CONDUIT STUBBED INTO ACCESSIBLE CEILING SPACE. U.O.N. CONTRACTOR TO PROVIDE PULLSTRING AND BLANK COVER PLATE.
10	CCTV CAMERA LOCATION. PROVIDE FLUSH MOUNTED 4S BOX MOUNTED AT +18" U.O.N. PROVIDE 3/4" CONDUIT TO CPB-6, U.O.N.
11	DATA CABLEING CONTRACTOR TO LEAVE (1) CONDUIT OPEN FOR FUTURE CABLEING NEEDS. PROVIDE PULLSTRING IN OPEN CONDUIT.
12	CCTV CAMERA LOCATION. PROVIDE SURFACE MOUNTED 4S BOX AT 12" AFF. U.O.N. PROVIDE 3/4" CONDUIT TO CPB-6, U.O.N.
13	PROVIDE 3/4" CONDUIT TO CPB-6, U.O.N.
14	PROVIDE J-HOOK PATHWAY TO CABLE TRAY SUPPORT CABLES EVERY 4' WITH J-HOOK ATTACHED TO PERMANENT STRUCTURE.
15	SEE DETAIL 1/ET-5.5 AND DETAIL 2/ET-5.5 FOR LABELING DETAILS.




CONSULTANT



REVISIONS

APPROVALS

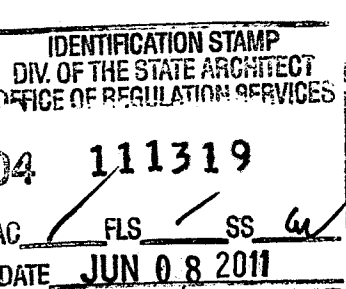

DESCRIPTION

LEVEL 1
SIGNAL PLAN -
EAST

DATE

04-19-11

JOB #

10086

SHEET #

E-2.6